



SLIDE BOLT LOCK ONE @ EACH JAMB  
**INTERIOR ELEVATION**


**SIDE ELEVATION**




**BOTTOM BAR**

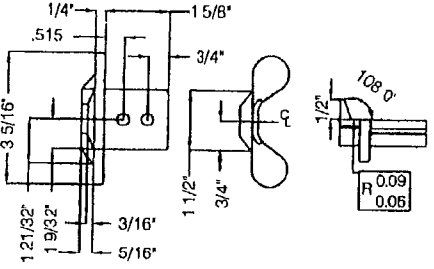


MATERIAL: CAST IRON  
**WINDLOCK**

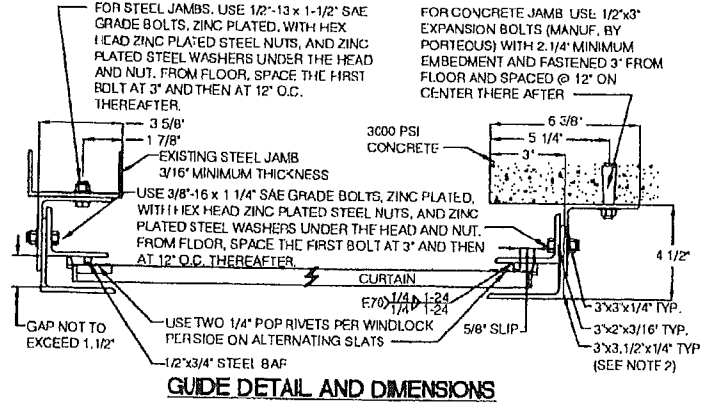

**GUIDE DETAIL AND DIMENSIONS**



**SLIDE BOLT LOCK**

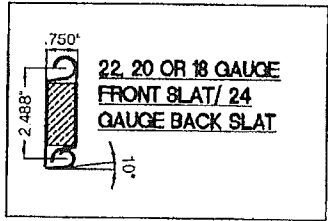

**22, 20 OR 18 GAUGE FRONT SLAT/ 24 GAUGE BACK SLAT**

STATE OF TEXAS  
  
**JOSEPH H. DIXON, JR.**  
 18627  
 LICENSED PROFESSIONAL ENGINEER  
 SEAL 4/30/13

**ABC**  
 ASTA Door Corporation  
 4255 McEver Industrial Dr.  
 Acworth, GA 30101  
 PH: (770) 924-2600/Fax: (770) 974-1455  
 www.aslador.com

**600 SERIES INSULATED SLAT  
 CERTIFIED WINDLOAD AND IMPACT  
 RATED ROLLING STEEL SERVICE  
 DOOR**

SCALE: VARIES (DO NOT SCALE DRAWINGS)  
 TOLERANCES  
 FRACTION = +/- 1/32  
 .X = +/- .032  
 .XX = +/- .015  
 .XXX = +/- .005 <= /- .5  
 DRAWN BY: BCLLC  
 ISSUE: 08-23-12

TEST SIZE	DESIGN PRESSURE	TEST PRESSURE
18'-6" W x 10' H	480.0/-45.0 PSF	475.0/-67.50 PSF
MODELS	TEST LOCATION ELEMENT-ORLANDO 124 PREMIER ROAD ORLANDO, FL 32822	
622IM-22 GAUGE 620IM-20 GAUGE 618IM-18 GAUGE	TEST REPORT #CSP010181P TEST DATES: 7/16/12 - 7/18/12	

Summary of Welded Jamb Connections  
E-Guide to Steel Jamb

Series	Door ID	Slat gage	Tested Door* 16'-6" wide	Design Wind Load		Job No.	maximum			all weld spacings are maximums**			
				Pos psf	Neg psf		slip in	P1pf catenary plf	P1nf catenary plf	Slot size	Weld in Slot Only min. 3/16" jamb	Weld in Slot plus Fillet Weld at Toe 3/16" jamb	
										in slot only	in slot	at toe	
<b>1/4" Standard Wall Angle</b>													
400	418FIM	18		55.0	55.0	32022	0.625	2000	2000	9/16" x 3/4"	1/4" fillet weld**	1/4" fillet weld**	1/4 x 1-1/2
	420FIM	20		55.0	55.0	"	0.625	2000	2000	9/16" x 3/4"	12" o.c.	12" o.c.	12" o.c.
	422FIM	22	Test	55.0	55.0	"	0.625	2000	2000	9/16" x 3/4"	12" o.c.	12" o.c.	12" o.c.
600	618IM	18		50.0	45.0	32022	0.625	1881	1663	9/16" x 3/4"	1/4" fillet weld**	1/4" fillet weld**	1/4 x 1-1/2
	620IM	20		50.0	45.0	"	0.625	1881	1663	9/16" x 3/4"	12" o.c.	12" o.c.	12" o.c.
	622IM	22	Test	50.0	45.0	"	0.625	1881	1663	9/16" x 3/4"	12" o.c.	12" o.c.	12" o.c.


\* doors tested with 1/2" bolts @ 12" o.c. connecting to 3/16" steel jamb per drawing

\*\* fillet weld around full perimeter of slot

\*\*\* no spacings exceed the fastener spacing of the test

**GENERAL NOTES:**

- STEEL USED FOR SLATS IS ASTM-A653 WITH MINIMUM YIELD OF 50 KSI AND TENSILE OF 60 KSI.
- GUIDES COMPOSED OF STRUCTURAL STEEL ANGLES WITH MINIMUM .1875" THICKNESS.
- INSULATION TO BE 5/8" POLYSTYRENE FOAM. EFFECTIVE INSULATING VALUE R= 5.0.
- THE WINDLOCKS ARE ATTACHED TO EVERY OTHER SLAT BEGINNING AT THE BOTTOM SLAT. WINDLOCKS ARE ATTACHED USING TWO - 1/4" RIVETS.
- THIS DOOR HAS BEEN DESIGNED AND TESTED IN ACCORDANCE WITH THE FLORIDA BUILDING CODE AND THE INTERNATIONAL BUILDING CODE. THE DESIGN WIND PRESSURES REQUIRED FOR ANY DOOR SHALL BE DETERMINED USING THE APPROPRIATE SECTION OF THE CODE HAVING JURISDICTION WHERE THE BUILDING IS LOCATED.
- THIS DOOR HAS BEEN SUCCESSFULLY TESTED TO:
  - THE UNIFORM STATIC AIR PRESSURE TEST PER ASTM E-330 AND ANSI/DASMA 108 TO A DESIGN LOAD OF +50.0 & -45.0 PSF
  - THE LARGE MISSILE IMPACT TEST PER TAS 201 AND ANSI/DASMA 115 WITH THE IMPACT DIRECTION TOWARD THE EXTERIOR FACE OF THE SLATS.
  - THE CYCLIC WIND PRESSURE TEST PER TAS 203 AND ANSI/DASMA 115.
  - REFERENCE ELEMENT-ORLANDO, TEST REPORT #ESP010181P, TESTING DATES: 7/16/12 - 7/18/12.
- BOTTOM BAR ASSEMBLY FASTENED 5 3/4" FROM EACH END AND 12" O.C. FROM CENTER USING 5/16" x 1" CARRIAGE BOLTS.

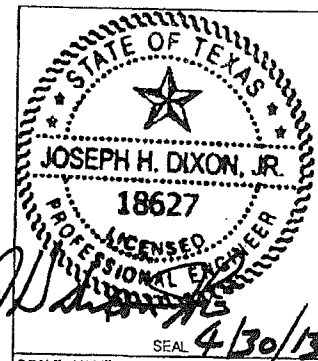

**ASTA**  
ASTA Door Corporation  
4255 McEver Industrial Dr.  
Acworth, GA 30101  
PH: (770) 924-2600/Fax: (770) 974-1455  
www.astadoor.com

**600 SERIES INSULATED SLAT  
CERTIFIED WINDLOAD AND IMPACT  
RATED ROLLING STEEL SERVICE  
DOOR**

SCALE: VARIES (DD NOT SCALE DRAWINGS)  
TOLERANCES  
FRACTION = +/- 1/32  
.X = +/- .032  
.XX = +/- .015  
.XXX = +/- .005 < -/ -5  
  
DRAWN BY: BCLLC  
ISSUE: 08-23-12

<b>TEST SIZE</b> 16'-6"W x 10'H	<b>DESIGN PRESSURE</b> +80.0/-45.0 PSF	<b>TEST PRESSURE</b> +75.0/-67.00 PSF
<b>MODELS</b> 622IM-22 GAUGE 620IM-20 GAUGE 618IM-18 GAUGE	<b>TEST LOCATION</b> ELEMENT-ORLANDO 124 PREMIER ROAD ORLANDO, FL 32822	
<b>TEST REPORT #ESP010181P</b> TEST DATES: 7/16/12 - 7/18/12		